RETAINING WALL/LEVEL BACKFILL B




CITY OF FULLERTON

COMMUNITY DEVELOPMENT DEPARTMENT

303 W. COMMONWEALTH AVENUE FULLERTON CA 92832

(714) 738-6541

45 LBS/FT^3 E.F.P.

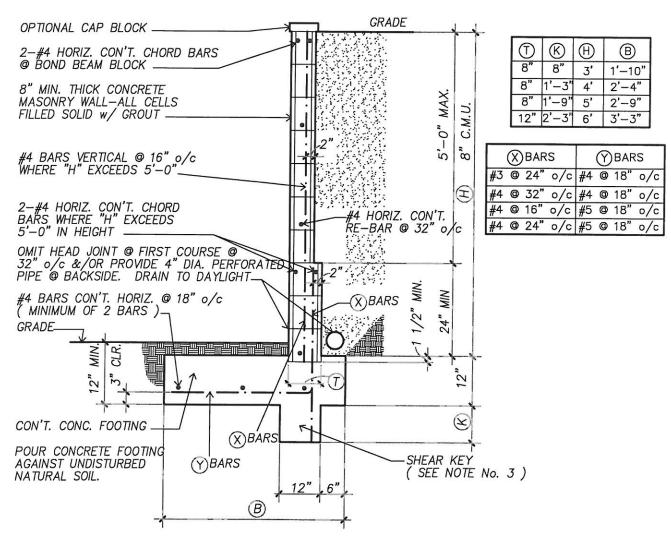

NOTES:

- 1. CONCRETE AND GROUT SHALL BE MACHINE MIXED, 2,500 P.S.I. @ 28 DAY ULTIMATE COMPRESSIVE STRENGTH.
- 2. CONCRETE MASONRY BLOCK SHALL BE GRADE 'A' UNITS, PER A.S.T.M. C90-52.
- 3. IT IS ASSUMED THAT THERE IS NO SURCHARGE ON THE WALL.
- 4. FINISH GRADE SHALL BE LEVEL ABOVE & BELOW THE WALL FOR A DISTANCE EQUAL TO THE WALL HEIGHT.
- 5. GROUT SHALL BE 1 PART CEMENT TO 3 PARTS SAND. (MIN. 1500 P.S.I.)
- 6. ALL BACKFILL SHALL BE BIRD'S EYE GRAVEL (1/4" MAX) OR WASHED SAND.
- 7. MINIMUM REINFORCING BAR LAP SHALL BE 40 BAR DIAMETERS, TYP.