


Residential HVAC Change-Out Requirements (Climate Zone 8)

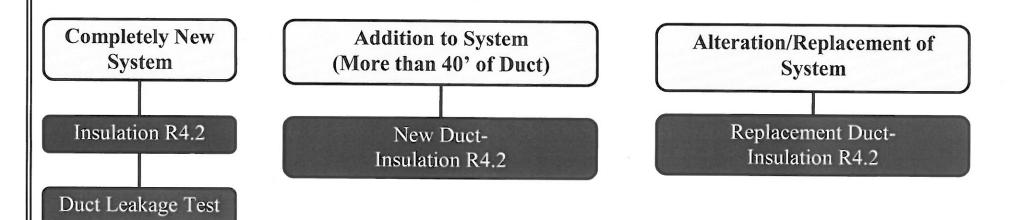

Notes:

- Refer to the 2007 California Energy Code for further requirements.
- Duct sealing shall be in accordance with Section 150(m) of the 2007 California Energy Code and with UL181, UL181A, and UL 181B of the UL Standards.
- Single phase air conditioners and heat pumps with an output capacity below 65,000 Btu/hr must have a minimum 13 Seasonal Energy Efficiency Ratio (SEER).
- Refrigerant Charge is mandatory for New, Added, or Replacement Split Systems, only.
 - o Completion of select CF-6R and CF-4R forms is required.